



西安电力高等专科学校
XI'AN ELECTRIC POWER COLLEGE

2020



“

+

”

2020

1

2

12

3

“

+

”

“

”

4

5

2020

1

“

”



“ ”

2

“ + ”

3

“ ”
“ ”

“ ”

4

530101

53	530101	44	6-28-01		

1.

1

2



- 3
- 4

- 5
- 6

- 7
- 8
- 2
- 1
- 2

- 3
- 4
- 5
- 6

- 7

- 8
- 9
- 10
- 11

- 3
- 1
- 2
- 3

- 4
- 5
- 6
- 7

Aut oCAD

8

9

10

11

12

13

14

1			
			1 2 3 4
2			

			1. 2 3
			3
4			1. 2 3
			1. 2 3

•†D œ

6			1800
			1. AB 2 3
7			
			1. 2 3
8			Windows Office Internet

			1. 2 3
9			1. 2 3
10			1. 2 3
11			1. 2 3

12			
			1. 2 3
13			
14			8

1.

15	I		
			1. 2. 3.
16			
17	I		
18			

			1. 2. 3. 4. 5.
19	Aut oCAD I		1. CAD 2. Aut oCAD 3.
20			1. 2. 3. 4. 5.

21			
			1. 2. 3. 4. 5. 6.
22			T
			1. 2. 3. 4.

--	--	--

23

I

			1. 2 3
26			
			1. 2 3 4 5 6 7.
27			4
			1 2 3 4 5 6 7 8

28			
			1. 2. 3. 4. 5.
29			
30	II		
			1. 2. 3. 4.

31			
			1. 2. 3. 4. 5.
32			

3

33	III		

			1. 2. 3.
34			
			1. 2. 3. 4. 5.
35			

4

36			

			1. 2 3
37			1. 2 3
38			1.

			2 3
39			

+

1.		2	
56	36		
2	1	28	
3	5	8	
	40		
4	17		
5			
6			
7.	16	4	2

4	0601034	2	2		KS	26	4	30		1*2*15			1.7
5	035	1	2		KS	32	4	36		1*3*12/A			2

										(15+3)W	(15+4)W	(15+4)W	(15+4)W	(12+7)W	(0+17)W	
21				6		KC	28	0	28						1W	1.6
22		0221202	I	1		KC	28	28	56	2*2*14						3.1
23		0101123	1	1		KS	66	18	84	3*2*14						4.7
24		0121141	2	2		KC	30	28	58		3*2*5/B+1W					3.2
25		0101124	I1	2		KS	42	12	54		B/3*2*9					3.0
26		0101125	12	3		KS	44	12	56			2*2*14				3.1
27		0121086	1	2		KC	34	16	50		1*4*13					2.8
28		0121087	2	3		KS	30	40	70			1*4*11+1W				3.9
29		0121129	AutoCAD I	4		KC	12	30	42				1*3*14			2.3
30		0121039		3		KC	28	28	56			2W				3.1
31		0201148		4		KC	28		28				1*2*14			1.6
32		0121109		2		KC	0	28	28			1W				1.6
33		0121159	I	5		KS	44	12	56					(2+3)*12		3.1
34		0101152		3		KS	56	28	84			1*4*14+1W				4.7
35		0101134		4		KS	48	0	48				2*3*8			2.7
36		0121149		4		KS	84	56	140				3*2*14+2W			7.8
37		0121116		4		KC		56	56				2W			3.1
38		0121185		5		KS	50	28	78					(2+3)*10+1W		4.3
39		0101150		4		KS	42	30	72				3*2*12/D			4.0
40		0101151	II	5		KS	52	8	60					(2+3)*12/E		3.3
41		0121120		5		KC	0	56	56					2W		3.1



1		18	1				
2		18	1				
3	---	18	1				
4		18	1				
5		18	1				
6		18	1				
7		18	1				
8		18	1				
9		18	1				
10		18	1				
11		18	1				
12		18	1				
13		18	1				
14		18	1				
15		18	1				
16		18	1				
17	e	18	1				
18		18	1				
19		18	1				
20		18	1				
21		18	1				
22		18	1				
23		18	1				

24		18	1			
25		18	1			
26		18	1			
27		18	1			
28		18	1			
29		18	1			
30		18	1			

				%	
				%	%
	754	532	222	19.47%	8.13%
	638	386	252	14.13%	9.22%
	650	332	318	12.15%	11.64%
	114	37	77	1.35%	2.82%
	504	0	504	0.00%	18.45%
	72	72	0	2.64%	0.00%
	2732	1359	1373	49.74%	50.26%

1

25.1

60%

40

75%

55%

2

5

6

3

4

1.

WiFi

2

4000 /

90

1		1	60 60
		2 330kV	-
2		1	1 2
		2	4 2
		3	4 2 4 4
		4	3 15 1
3		1	
		2	
4		1	300MW 600 MW 1000MW
5	()	1	
		2	10
6	(1	

7		1	3 3
8		1	
		2	
		3	
		4	
9		1	
10		1	20
		2	5
		3	EDA 40 40
11		1	
		2	20 17

3

200MW

110kV

3

4

5

1.

2

3

“ ” “ + ” “ + ”

1.

2

3

4

	4 (1)

1.


2

3

4

1

1	
2	
3	
4	
5	
6	
7	
8	
9	

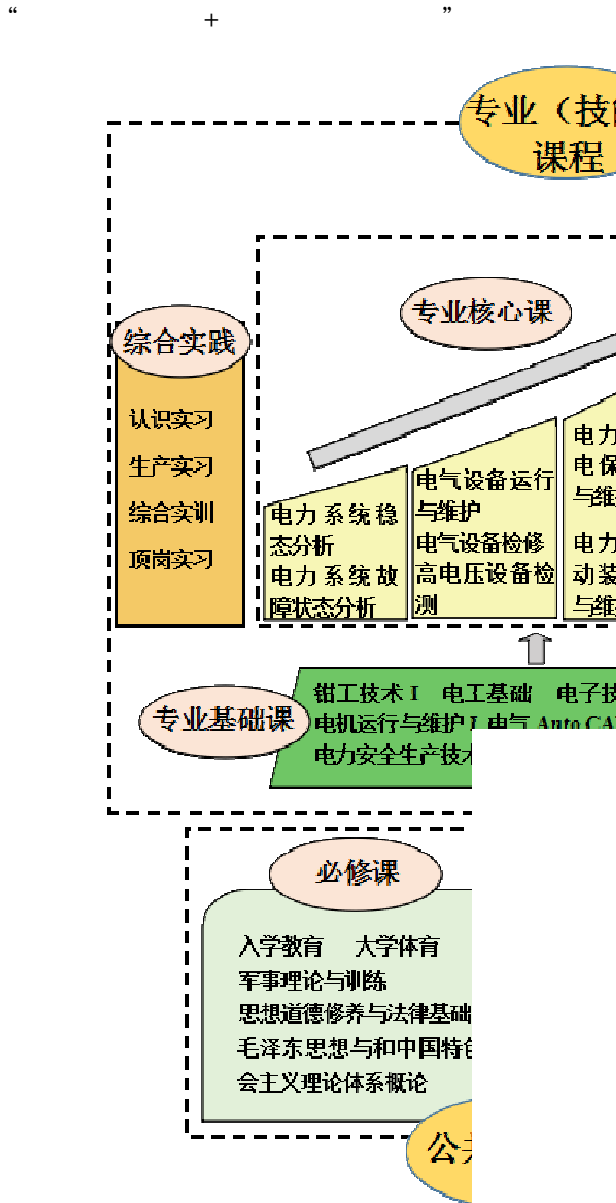

3

20 20

()

							/
							/

()		